


2010 ANNUAL DRINKING WATER QUALITY REPORT
Warwick Township Municipal Authority
“Rothsville” Water System
PWSID# 7360120

*Este informe contiene informacion muy importante sobre su agua de beber. Tradúzcalo ó hable con alguien que lo entienda bien.
(This report contains very important information about your drinking water. Translate it, or speak with someone who understands it.)*

WATER SYSTEM INFORMATION

This report shows our water quality and what it means. **If you have any questions about this report or concerning your water utility, please call the Warwick Township Municipal Authority (“WTMA”) office at (717) 627-2379.** We want you to be informed about your water supply. If you want to learn more, please attend any of our regularly scheduled meetings, held on the third Tuesday of each month at 7 p.m. at the Warwick Township Municipal Building, 315 Clay Road, Lititz, PA.

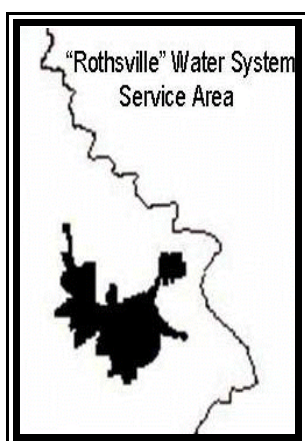

SOURCES OF WATER

The water source for WTMA's Rothsville Water System is a well located within Rothsville. The well is permitted to produce 288,000 gallons of water per day. There are two 440,000 gallon storage tanks which provide an emergency water supply. The Rothsville Water System serves 756 connections within the village of Rothsville. The Rothsville recharge zone can easily be identified by signs indicating the water supply area. **Please be mindful that pollution affects your water supply.**

In September, 2002, WTMA received approval of its Wellhead Protection Program from the PA Department of Environmental Protection (PA DEP). Since that time, WTMA and Warwick Township have continued source water protection efforts by forming partnerships for farm preservation and management of agricultural applications with farmers in the well recharge area and participating in water shed education. Persons wishing to serve on the Wellhead Protection Committee should contact the Authority office.

In 2005, the PA Dept. Of Environmental Protection (PA DEP) prepared a Source Water Assessment Report which identified the primary activities to which the water source is susceptible. On a scale from A (high priority) to F (low priority) the report rated Agricultural activities B and Residential activities C. The report is available for review at the Authority office upon request.

MONITORING AND TREATMENT

Our goal is and always has been, to provide to you a safe and dependable supply of drinking water. Four of WTMA's employees are State certified water operators who routinely monitor for contaminants in your drinking water according to federal and state laws. In addition, an outside laboratory takes random water samples throughout the system on a monthly basis. Test results are reported to PA DEP. Water from the Rothsville well is treated using chlorine and a nitrate removal process. Fluoride is **not** added to the treated water. Due to the limestone geology, water in the Rothsville system is hard, having between 21 and 24 grains of hardness.

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791).

The following tables show the monitoring results for the period of **January 1 to December 31, 2010**. The State allows us to monitor for some contaminants less than once per year because the concentrations of these

contaminants do not change frequently. Some of our data is from prior years in accordance with the Safe Drinking Water Act. The date has been noted on the sampling results table.

DEFINITIONS AND ABBREVIATIONS

Action Level (AL) - The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Maximum Contaminant Level (MCL) - The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal (MCLG) - The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum Residual Disinfectant Level (MRDL) - The highest level of a disinfectant allowed in drinking water. There is convincing evidence that the addition of disinfectant is necessary for control of microbial contaminants.

Treatment Technique (TT) - A required process intended to reduce the level of a contaminant in drinking water.

mg/L - milligrams per liter

ppq - parts per quadrillion or picograms per liter

ppm - parts per million

ppt - parts per trillion or nanograms per liter

ppb - parts per billion or micrograms per liter ($\mu\text{g/L}$)

CHEMICAL CONTAMINANTS								
Contaminant	MCL	MCLG	Highest Level Detected	Range of Detections	Units	Sample Date	Violation	Sources of Contamination
Nitrates	10	10	7.0	5.7 to 7.0	ppm	2010	No	Run off from fertilizer use, Leaching from septic tanks, sewage, Erosion of natural deposits
TTHM (total trihalomethanes)	80	NA	7.0	7.0	ppb	2008	No	By-product of drinking water chlorination
HAA5 Haloacetic acid	60	NA	n/d	NA	ppb	2008	No	By-product of drinking water chlorination
Chlorine (MRDL)	4	4	0.76	0.49 - 0.76	ppm	2010	No	Water additive used to control microbes

Nitrate in drinking water at levels above 10 ppm is a health risk for infants of less than six months of age. High nitrate levels in drinking water can cause blue baby syndrome. Nitrate levels may rise quickly for a short period of time because of rainfall or agricultural activity. If you are caring for an infant, you should ask advice from your health care provider.

LEAD AND COPPER								
Contaminant	Action Level	MCLG	90 th Percentile Value	# of Sites Above AL of Total Sites	Units	Sample Date	Violation	Sources of Contamination
Copper	1.3	1.3	0.32	0 of 10	ppm	2010	No	Corrosion of household plumbing systems Erosion of natural deposits Leaching from wood preservatives
Lead	AL=15	0	7	0 of 10	ppb	2010	No	Corrosion of household plumbing systems Erosion of natural deposits

INFORMATION ABOUT LEAD

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. WTMA is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can

minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

OTHER ORGANIC CONTAMINANTS								
Contaminant	MCL	MCLG	Highest Level Detected	Range of Detections	Units	Sample date	Violation	Sources of Contaminants
Synthetic Organic Chemicals (SOCs)	Various concentrations depending on chemical		ND	All SOCs tested were below detection limits	ppb	2009	No	Potential residue from pesticides, herbicide, insecticide, discharge from chemical factories, discharge from petroleum factories.
Volatile Organic Chemicals (VOCs)	Various concentrations depending on chemical		ND	All VOCs tested were below detection limits	ppb	2009	No	Potential discharge from industrial chemical factories, petroleum factories, textile-finishing factories, pharmaceutical factories, rubber/plastic factories, dry cleaners.

WHAT THIS MEANS

As you can see under the 'violations' heading in the first table, the "Rothsville" water system had **no** violations in 2010. WTMA has learned through monitoring and testing that a very small amount of a few constituents have been detected. All sources of drinking water are subject to potential contamination by constituents that are naturally occurring or man made. Those constituents can be microbes, organic or inorganic chemicals, or radioactive materials. MCL's are set at very stringent levels for health effects. The EPA has determined that your water is safe at these levels. To understand the possible health effects described for many regulated constituents, a person would have to drink two liters of water every day at the MCL level for a lifetime to have a one-in-a-million chance of having the described health effect. WTMA is proud that your drinking water meets or exceeds all Federal and State requirements.

EDUCATIONAL INFORMATION

In accordance with our Wellhead Protection Program, WTMA continues to encourage people to take positive steps that will protect our water supply. One initiative is to join with other organizations in supporting the Lititz Run Watershed Alliance's Water Day event for all Warwick School District fifth grade students. This educational event provides hands on activities for students to experience the importance of protecting our water supply. WTMA continues to look at positive steps that can be taken, both by our municipalities and citizens, to protect our water supply. Periodically, information about what you can do to enhance Wellhead Protection will be enclosed in your quarterly billing. We encourage you to read this information when it is provided and to do your part in protecting our water supply.



2011 Water Day - 5th Grade Students tour the Wastewater Treatment Plant

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive materials, and can pick up substances resulting from the presence of animals or from human activity. Contaminants that may be present in source water include:

- Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife.
- Inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban stormwater run-off, industrial or domestic wastewater discharges, oil and gas production, mining or farming.
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff and residential uses.
- Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production and can also come from gas stations, urban stormwater run-off and septic systems.
- Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, EPA and DEP prescribe regulations which limit the amount of certain contaminants in water provided by public water systems. FDA and DEP regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

Drinking water, including bottle water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk.

More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's *Safe Drinking Water Hotline* at (800) 426-4701.

In order to comply with the new Pennsylvania Tier-One Notification regulations, WTMA has contracted with Swift-Reach, Inc. to provide telephonic notifications to our customers for water emergencies. These notifications will only be issued for WATER EMERGENCIES. WTMA asks that you use one of these methods to make sure that we are able to contact you during a water emergency:

- Include your phone number with your next payment
- Go to the web portal at www.warwicktownship.org, click on SwiftReach 911 in the upper right-hand corner to enter your information.
- Provide your phone number by e-mail to WTMA@warwicktownship.org
- Call us at 627-2379.
- If you have a dial "1" solicitation blocker on your land line, you can insure that you receive water emergency calls by unblocking WTMA's number. To do this, call *58 from your home phone and follow the prompts.